




MINIMUM SIDEWALK WIDTHS	
5'	RESIDENTIAL
6'	COMMERCIAL

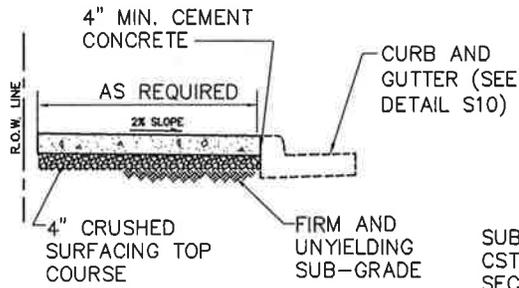

**TYPICAL SECTION**

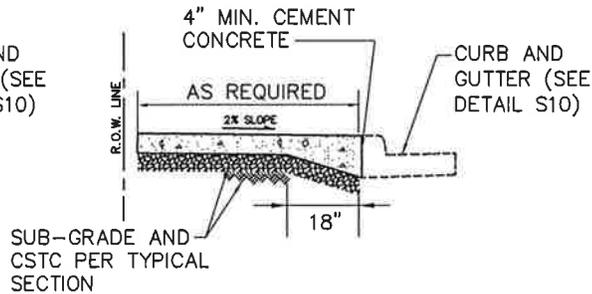


**SECTION AT INTERSECTIONS**

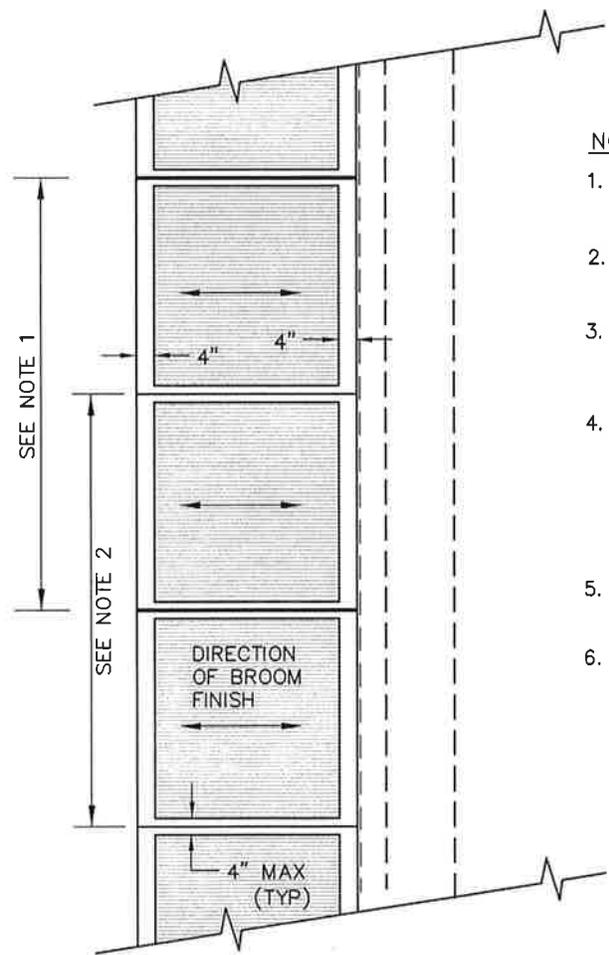


**PLAN**

**NOTES:**

1. EXPANSION JOINTS SHALL BE 3/8" x 4" ASPHALT SATURATED FELT PLACED AT 10' o.c.
2. DUMMY JOINTS SHALL BE 1" DEEP AND 1/4" WIDE PLACED AT 10' o.c.
3. ALL JOINTS SHALL BE CLEAN AND EDGED TO A 1/4" RADIUS. JOINTS SHALL BE FLUSH WITH THE FINISHED SURFACE.
4. ALL UTILITY POLES AND STREET SIGN POSTS IN SIDEWALK AREA NOT REQUIRED TO BE RELOCATED BY THE CITY ENGINEER SHALL HAVE A SQUARE SECTION OF CONCRETE SURROUNDED BY 3/8" EXPANSION JOINT MATERIAL AROUND THE POLE. THE JOINT SHALL BE NO CLOSER THAN 6" TO ANY SIDE OF THE POLE.
5. FORMS SHALL BE EITHER WOOD OR STEEL AND SHALL MEET ALL REQUIREMENTS OF THESE SPECIFICATIONS.
6. CONCRETE SHALL BE CLASS 3000  
3000 PSI 5-1/2 SACK WITH 6% AIR  
COARSE AGGREGATE GRADING NO. 2  
FINE AGGREGATE CLASS 1

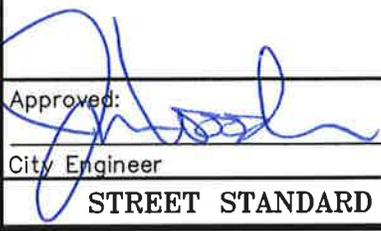Approved:  June 17, 2015  
City Engineer Date  
**STREET STANDARD DETAIL**



Dwg No: **S8**  
**CEMENT CONCRETE SIDEWALK**