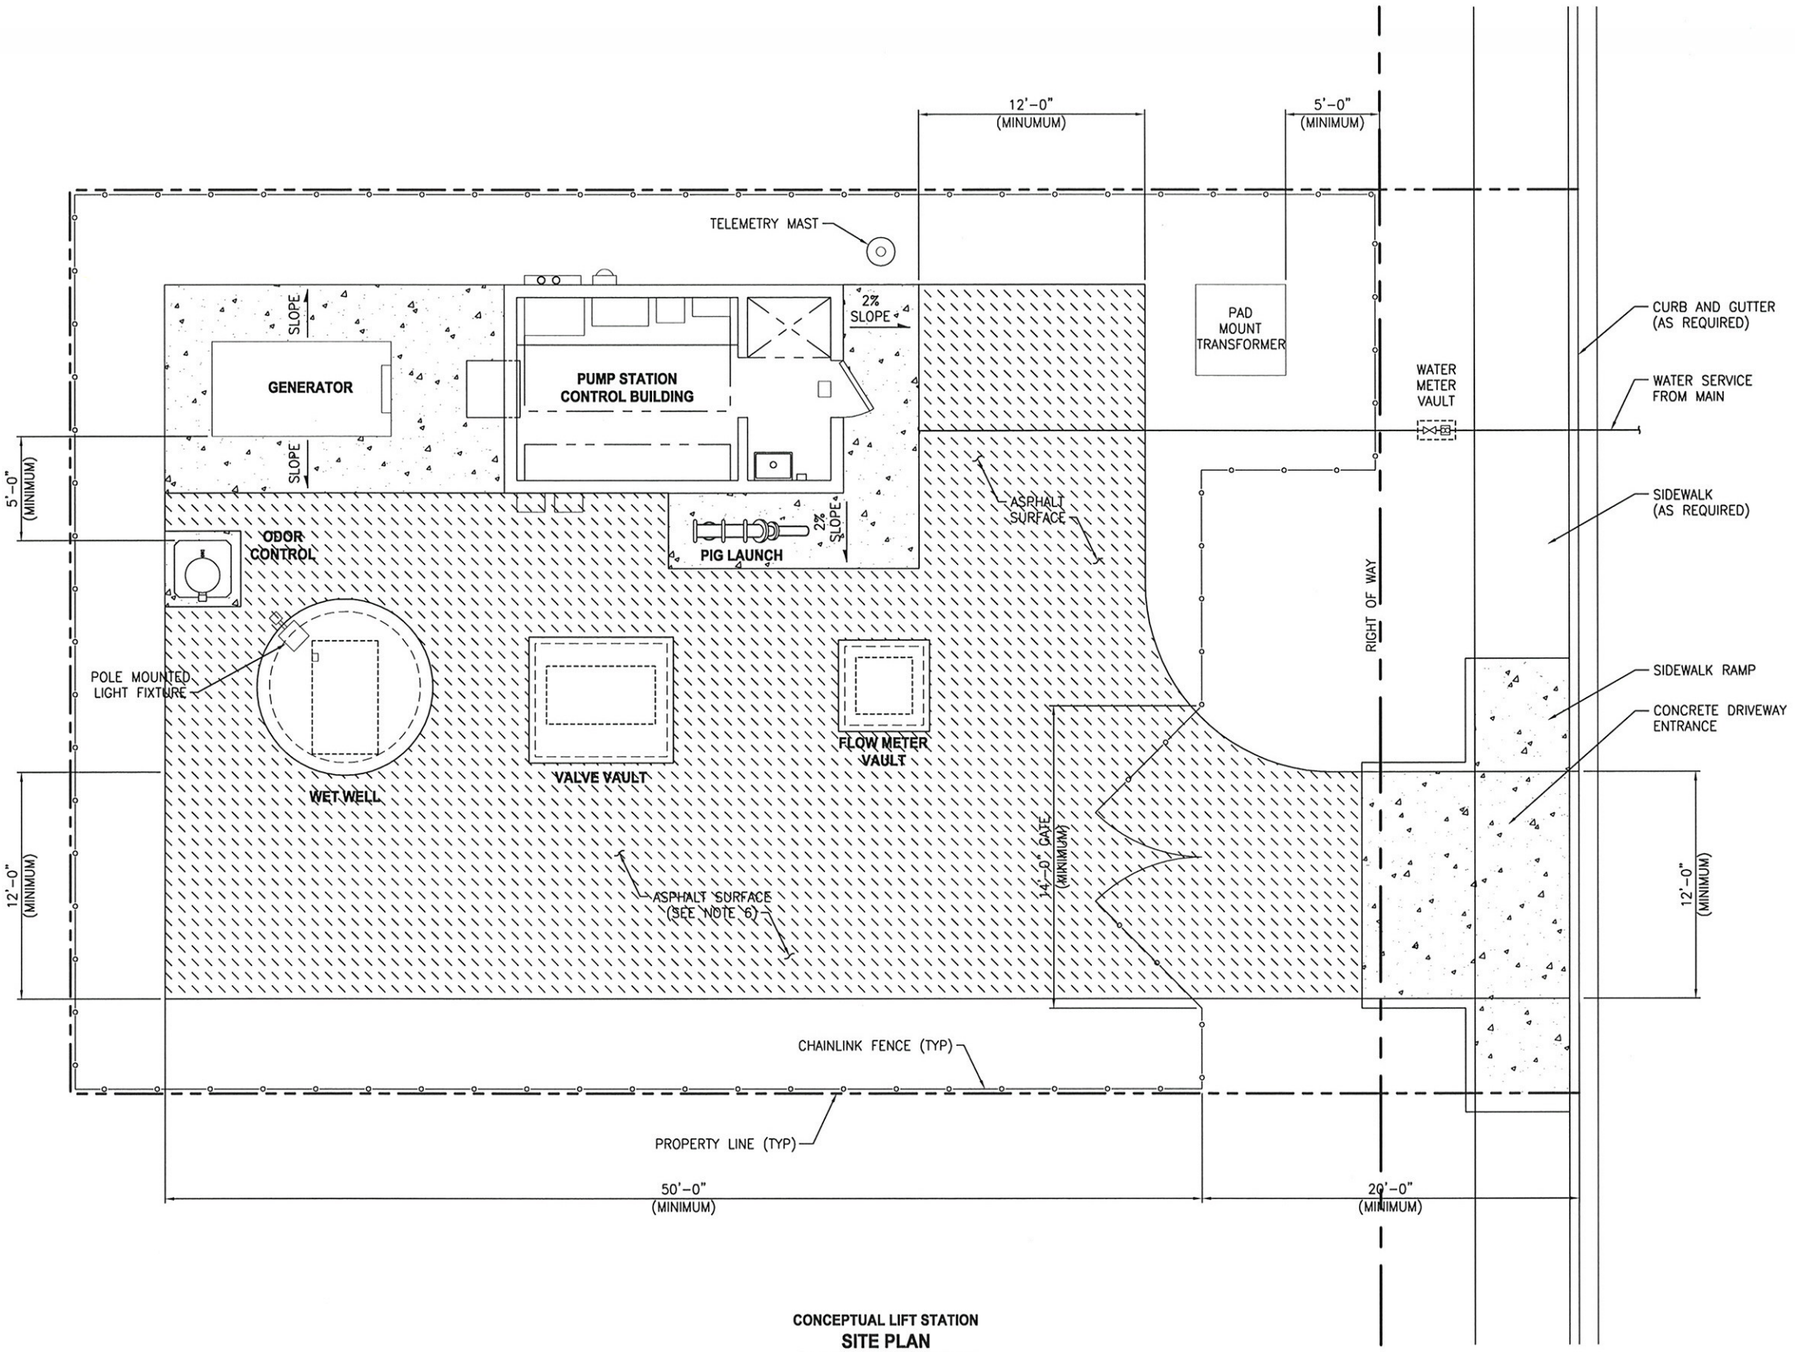

CONCEPTUAL LIFT STATION
SITE PLAN
NO SCALE

NOTES:

1. LIFT STATION SITE LAYOUT SHOWN IS THE MINIMUM REQUIREMENT PER THE CITY OF BONNEY LAKE. ACTUAL LAYOUT MAY VARY DEPENDING ON LIFT STATION SIZE AND ACTUAL SITE CONFIGURATION.
2. REFER TO CITY OF BONNEY LAKE PUBLIC WORKS DESIGN STANDARDS SECTION 515 – "SANITARY SEWER STANDARDS" FOR ADDITIONAL REQUIREMENTS NOT SHOWN.
3. SEE STANDARD DETAIL SS19 FOR CONTROL BUILDING AND UNDERGROUND PIPING LAYOUT.
4. ALL ACCESS HATCHES IN ASPHALT SURFACING SHALL BE FLUSH TO GRADE. ALL ACCESS HATCHES SHALL BE SUITABLE FOR H–20 WHEEL LOADING.
5. WATER SERVICE PIPING SHALL PER CITY OF BONNEY LAKE PUBLIC WORKS DESIGN STANDARDS SECTION 400 – "WATER SYSTEM STANDARDS".
6. ALL IMPERVIOUS SURFACES SHALL BE SLOPED TO DRAIN AWAY FROM EQUIPMENT, BUILDING, VAULTS AND WET WELL.
7. PROPERTY LINE SETBACKS NOT SHOWN. SEE ZONING REQUIREMENTS.
8. STORMWATER MITIGATION NOT SHOWN.

Approved: October 22, 2007 City Engineer Date SANITARY SEWER STANDARD DETAIL	City of BONNEY Lake	Dwg No:	SS18
		CONCEPTUAL LIFT STATION SITE PLAN	