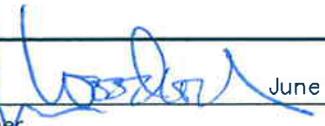


NOTES:

1. EACH VALVE SHALL BE PROVIDED WITH THE FOLLOWING OLYMPIC FOUNDRY VALVE BOX PARTS OR APPROVED EQUALS; LID PART NO. 13-5010, TOP PART NO. 13-5020, & BASE PART NO. 13-5021.
2. 15" MINIMUM, 36" MAXIMUM FOR OPERATOR NUT. EXTENSION MAY BE REQUIRED, SEE DETAIL W19.
3. AS REQUIRED BY THE CITY, A WHITE 4"x4" CONCRETE MARKER POST SHALL BE INSTALLED WITH THE VALVE BOX IN UNIMPROVED AREAS.

1	Specified Olympic Foundry Valve Box & Removed Fogtite B-9 W/ Fogtite B-9 Traffic Lid	10/01/09
Rev No.	Revisions	Date
Approved: 	City of BONNEY <i>Lake</i>	Dwg No: W16
City Engineer	Date	VALVE BOX
WATER STANDARD DETAIL		