


P.R.V. SHALL HAVE AN INTEGRAL BYPASS

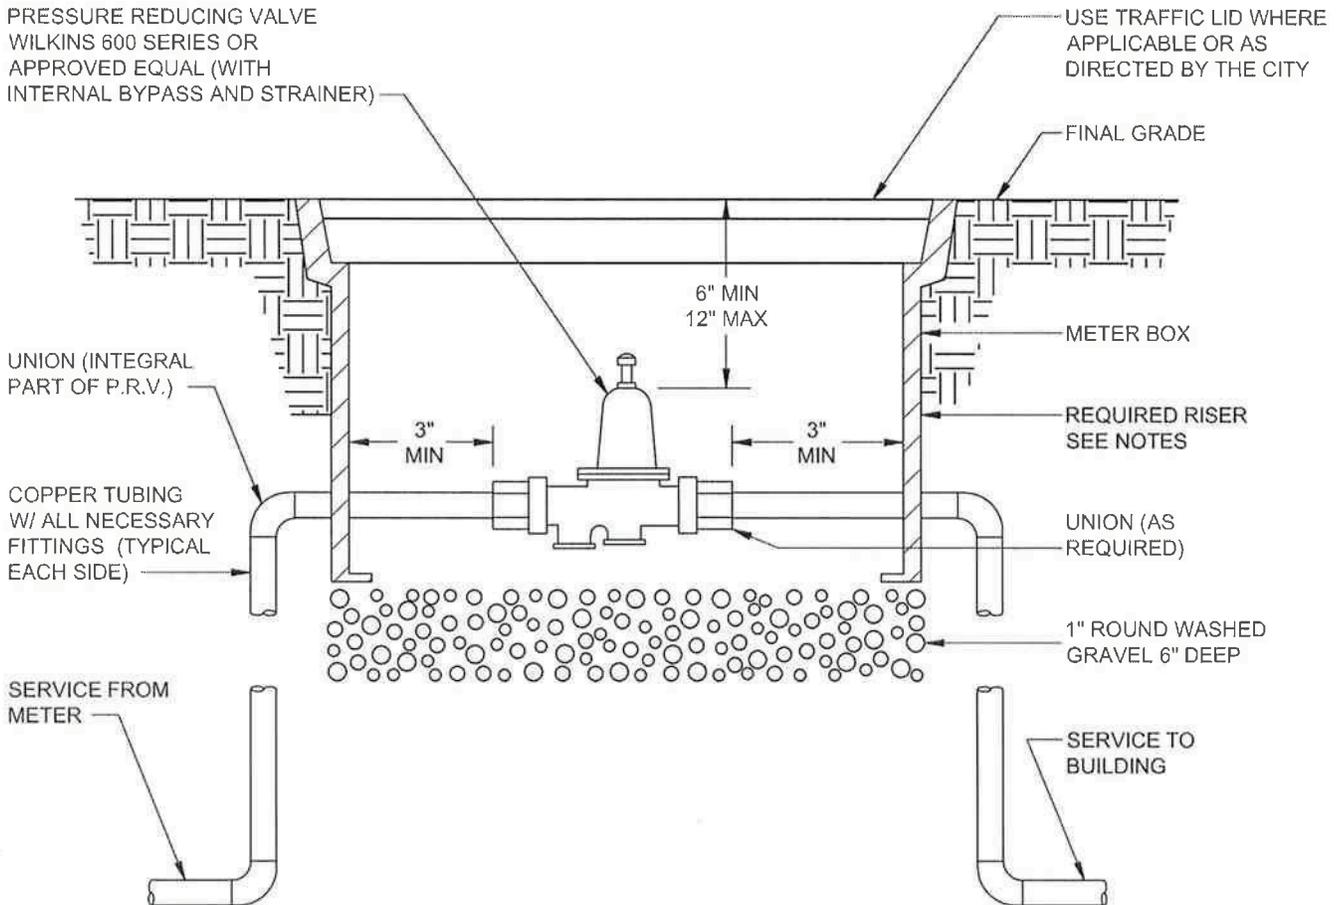

NOTES:

1. WHERE P.R.V. IS INSTALLED ON EXISTING SERVICE, CUT IN EXISTING SERVICE, INSTALL NEW COPPER TUBING & NECESSARY FITTINGS REQUIRED TO MAKE A COMPLETE P.R.V. INSTALLATION.
2. METER BOX SHALL BE MIDSTATES PLASTICS METER BOX NUMBER MSBCF1118 - 12xL.
3. REQUIRED RISER SHALL BE 6 INCH.
4. P.R.V. SIZE SHALL BE 1 INCH.

Approved:  December 7, 2010
 City Engineer Date
 WATER STANDARD DETAIL



Dwg No: **W23**
INDIVIDUAL PRV