

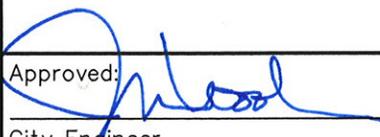
SPECIAL NOTE:
 OPERATION SHALL BE BY CITY PERSONNEL ONLY. CONTRACTOR SHALL NOT OPERATE VALVE

NOTES:

1. OD STEEL PIPE SHALL USE STAINLESS STEEL SLEEVE (FUSION COATED).
- 2.. COMPLETELY REMOVE PROTECTIVE COATING ON STEEL PIPE FOR TAPPING SLEEVE. COVER ALL BARE METAL WITH COAL TAR ENAMEL OUTSIDE OF SLEEVE.

CONSTRUCTION NOTES:

- ① STAINLESS STEEL TAPPING SLEEVE. ROMAC OR APPROVED EQUAL.

Approved:  June 17, 2005
 City Engineer Date
WATER STANDARD DETAIL



Dwg No: **W6**
WET TAP CONNECTION